




BOONE COUNTY, MISSOURI
Request for Bid #: 05-28FEB11 – Chiller Installation

ADDENDUM #1 - Issued February 22, 2011

This addendum is issued in accordance with the Introduction and General Conditions of Bidding and the Primary Specifications in the Request for Bid and is hereby incorporated into and made a part of the Request for Bid Documents. Bidders are reminded that receipt of this addendum should be acknowledged and submitted with Bidder's *Response Form*.

Specifications for the above noted Request for Bid and the work covered thereby are herein modified as follows, and except as set forth herein, otherwise remain unchanged and in full force and effect:

- I. **Add section 2.14. to the bid as follows:**
Relocate air separator to the south as necessary to connect new pump.
- II. **Add ssection 2.15. to the bid as follows:**
Coordinate controls with Brian Sheppers phone: 573-632-4247.
- III. **Add section 2.16. to the bid as follows:**
Paint or enclose refrigerant pipe insulation to protect against UV.
- IV. **Add the attached Engineers drawing to the Bid Documents as Exhibit A**

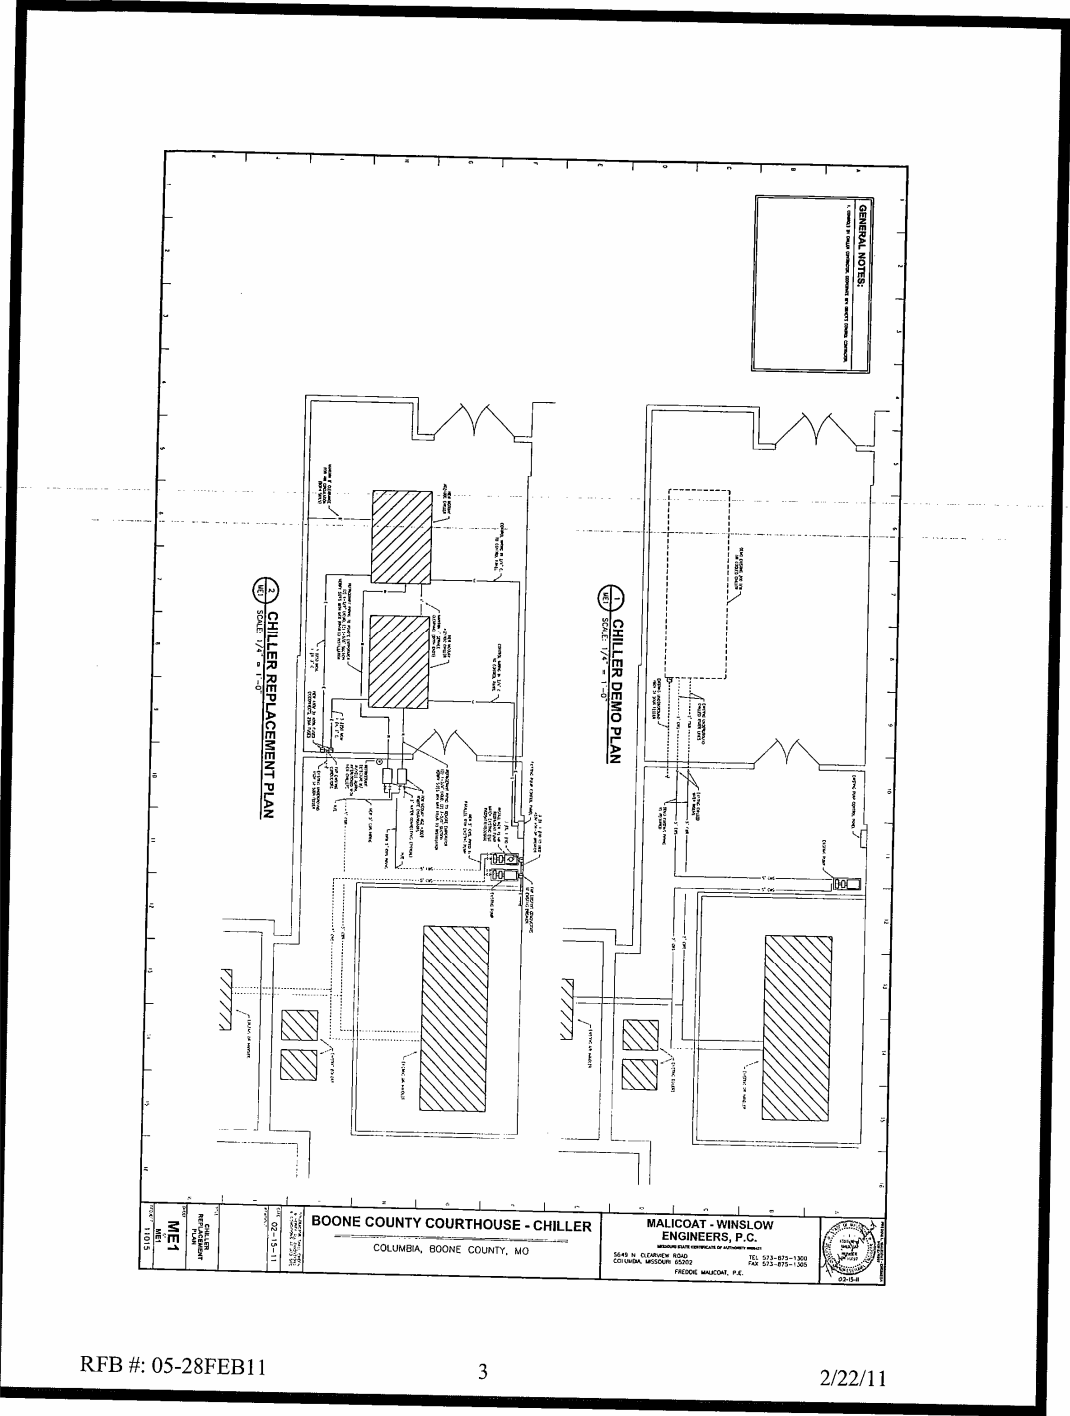

BOONE COUNTY COURTHOUSE - CHILLER COLUMBIA, BOONE COUNTY, MO	MALICOAT - WINSLOW ENGINEERS, P.C. <small>REGISTERED PROFESSIONAL ENGINEERS</small> STATE OF MISSOURI NO. 0000 COLUMBIA, MISSOURI 65203 FREDERICK, MISSOURI, P.E.	

By: _____
Tyson Boldan
Buyer

OFFEROR has examined copy of Addendum #1 to Request for Bid # **05-28FEB11 – Chiller Installation**, receipt of which is hereby acknowledged:

Company Name: _____

Address: _____

Phone Number: _____ Fax Number: _____

Authorized Representative Signature: _____ Date: _____

Authorized Representative Printed Name: _____