



NOTES:

- 1. SLAB TO BE LEVEL +/- 1/4"
- 2. FOOTING TO EXTEND A MINIMUM OF 30" BELOW UNDISTURBED SOIL AND FROST LINE.
- 3. FINAL SITE DESIGN IS THE RESPONSIBILITY OF THE SITE CONTRACTOR.
- 4. SOIL BEARING PRESSURE 2000 P.S.F. MIN.
- 5. MAXIMUM SOIL PLASTICITY INDEX OF 27.
- 6. CONCRETE STRENGTH SHALL BE A MINIMUM OF 3000 P.S.I.



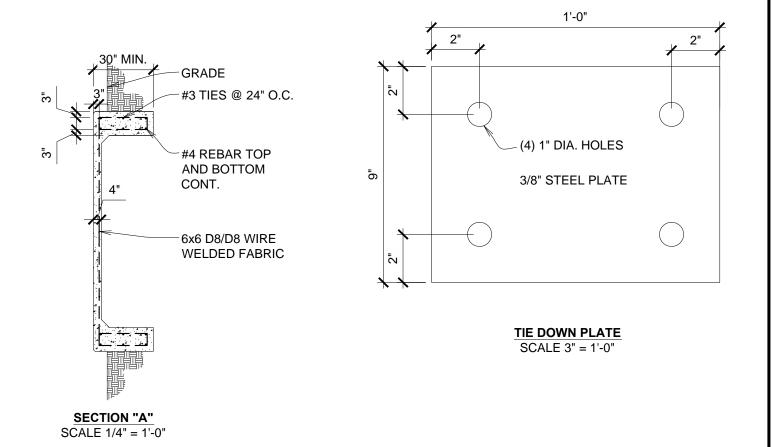

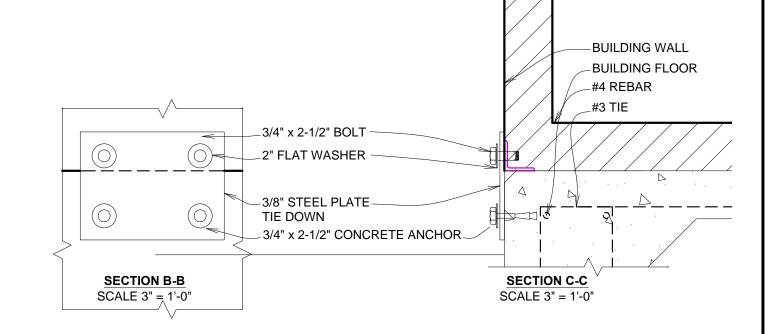

EQUIPMENT BUILDING FOUNDATION PLAN AND DETAILS

SCALE: 1" =10'-0"

DRAWING NO.

.